


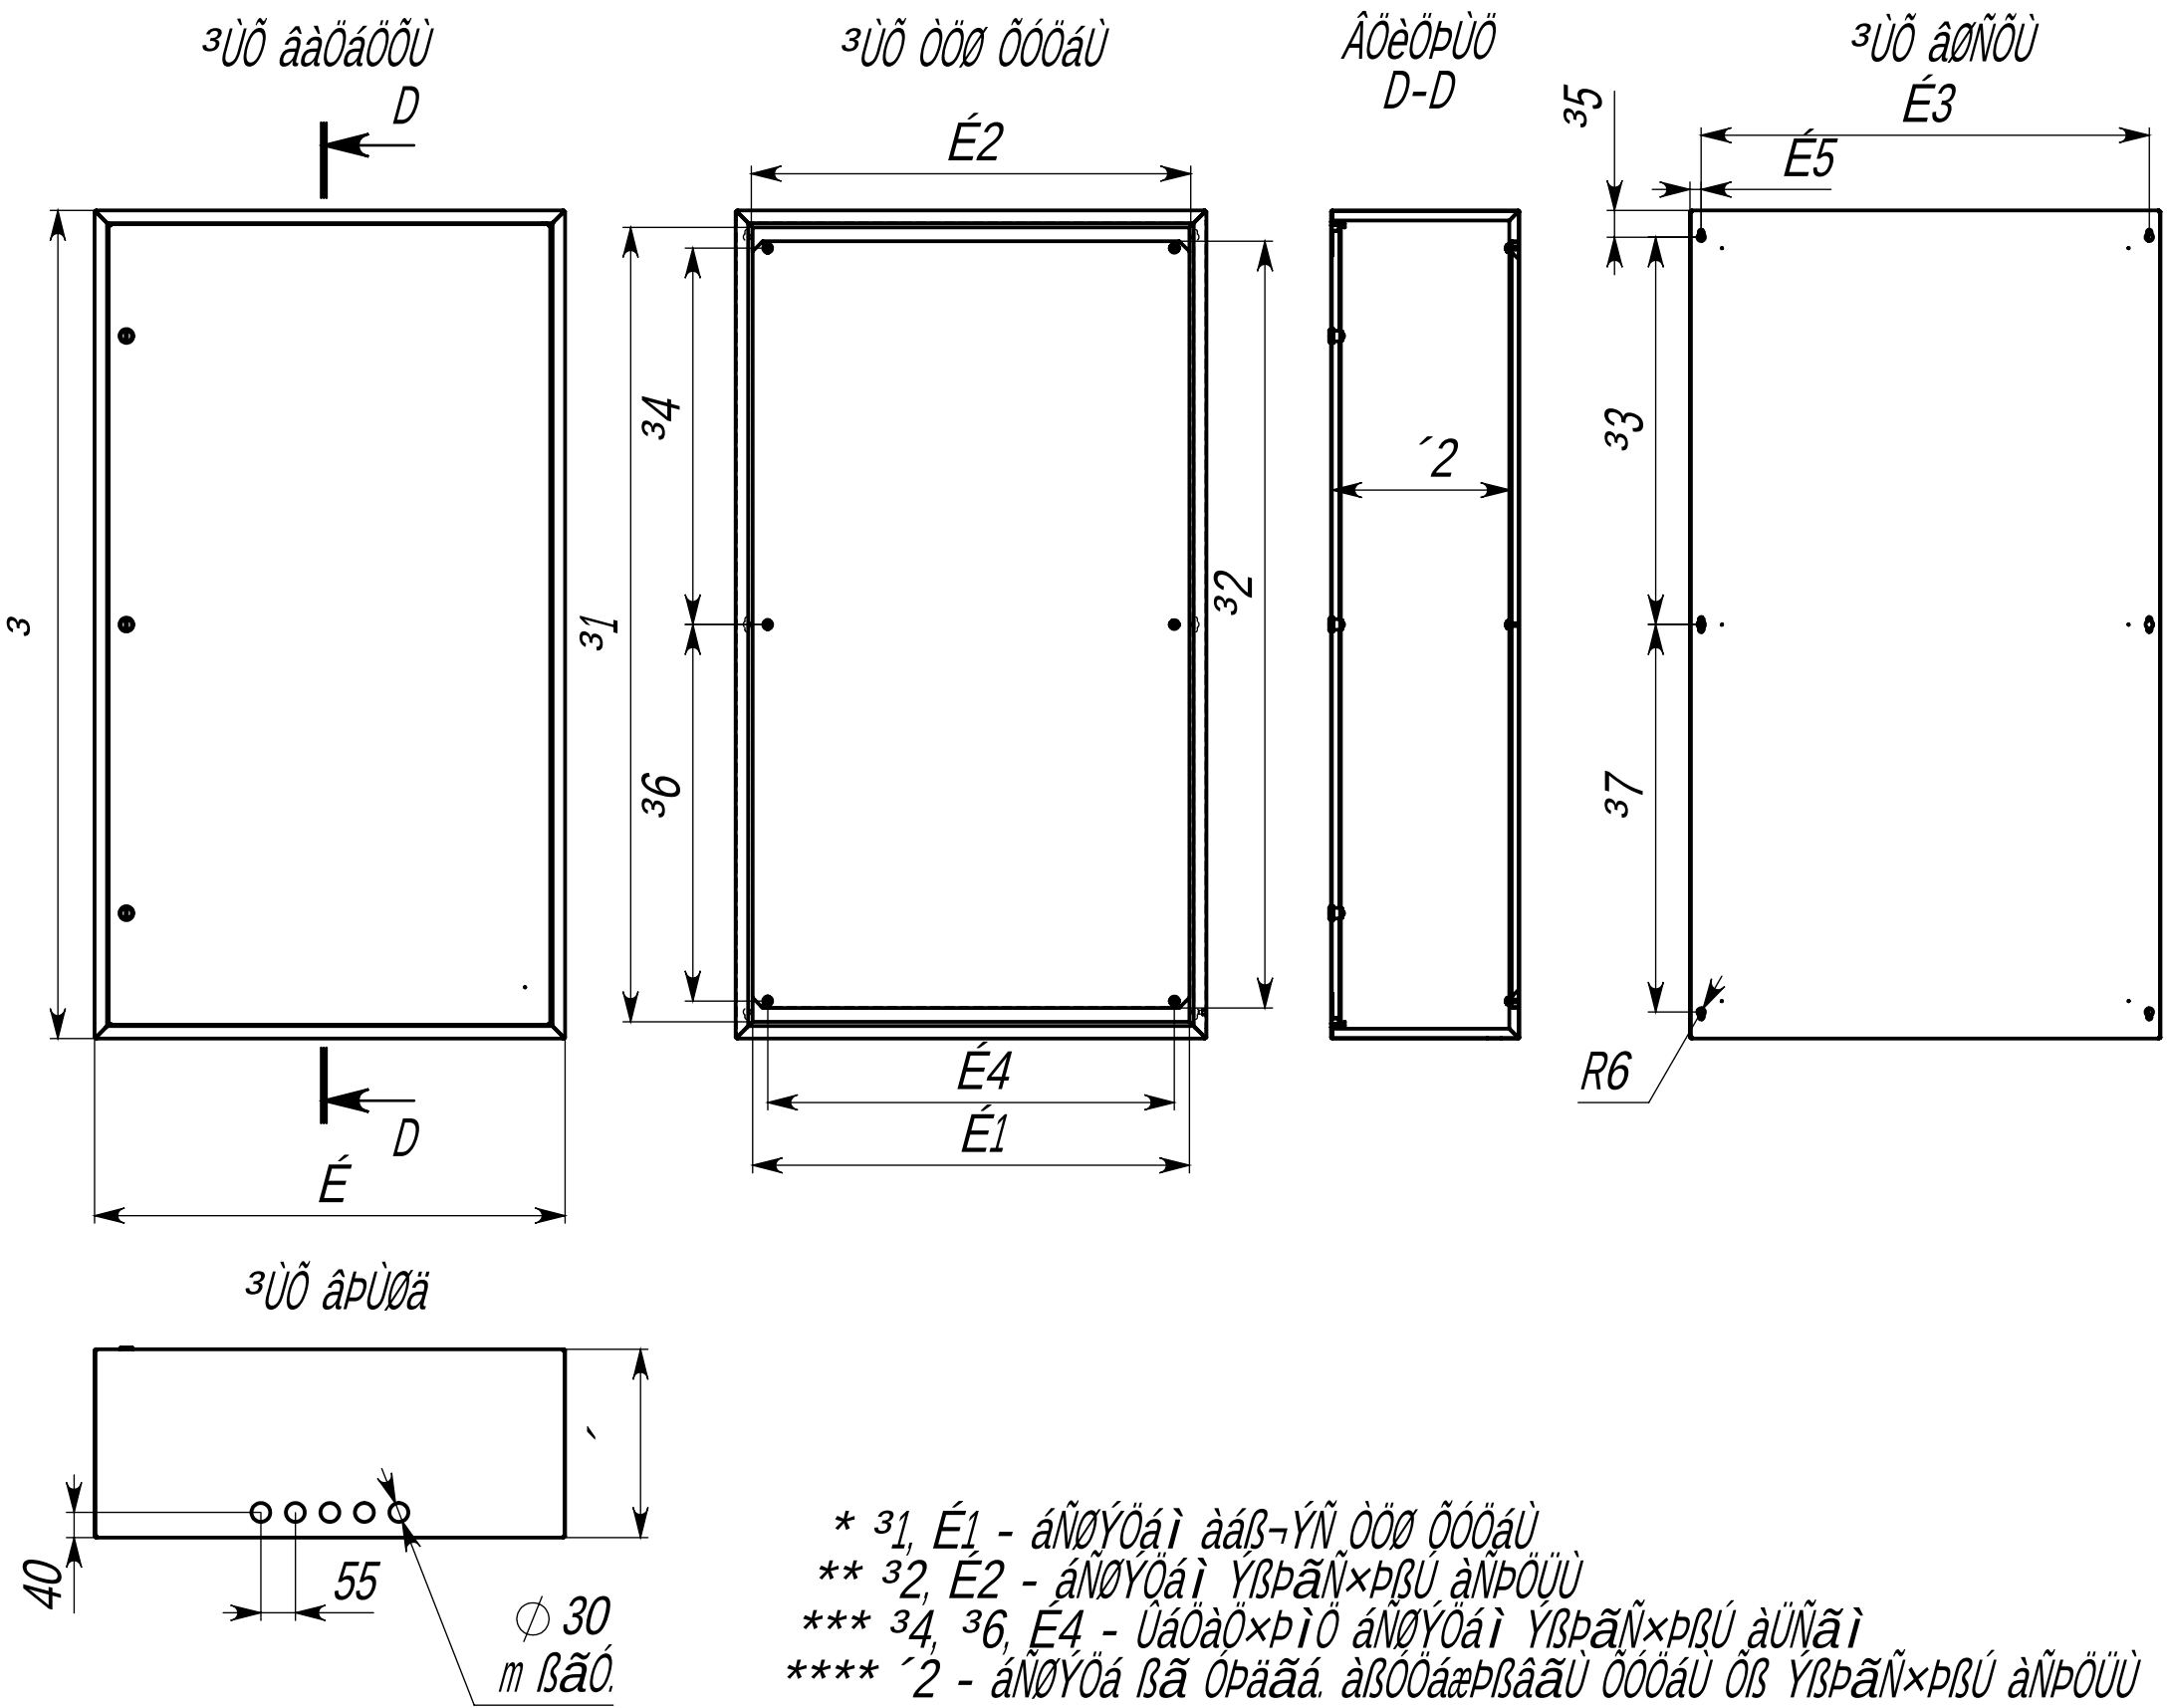

$\pm a\tilde{a}$	$\frac{1}{2}A-60.40.21$ ($\hat{E}\frac{1}{2}A-09$) IP31 EKF PROW I`	$^3, \acute{Y}\acute{Y}$	$\acute{E}, \acute{Y}\acute{Y}$	$\grave{,} \acute{Y}\acute{Y}$	$^3_1, \acute{Y}\acute{Y}$	$\acute{E}_1, \acute{Y}\acute{Y}$	$^3_2, \acute{Y}\acute{Y}$	$\acute{E}_2, \acute{Y}\acute{Y}$	$\grave{2}, \acute{Y}\acute{Y}$	$^3_4, \acute{Y}\acute{Y}$	$\acute{E}_4, \acute{Y}\acute{Y}$	$^3_3, \acute{Y}\acute{Y}$	$\acute{E}_3, \acute{Y}\acute{Y}$	$^3_5, \acute{Y}\acute{Y}$	$\acute{E}_5, \acute{Y}\acute{Y}$	$m, \acute{e}\tilde{a}$	$^3_6, \acute{Y}\acute{Y}$	$^3_7, \acute{Y}\acute{Y}$
Ia_{22-09}	$\hat{E}\frac{1}{2}A-60.40.21$ ($\hat{E}\frac{1}{2}A-09$) IP31 EKF PROW I`	600	400	210	552	352	552	332	195	530	280	535	335	32,5	32,5	3	-	-
Ia_{22-11}	$\hat{E}\frac{1}{2}A-60.40.40$ ($\hat{E}\frac{1}{2}A-11$) IP31 EKF PROW I`	600	400	400	552	352	552	332	385	530	280	535	335	32,5	32,5	3	-	-
Ia_{22-12}	$\hat{E}\frac{1}{2}A-60.60.40$ ($\hat{E}\frac{1}{2}A-12$) IP31 EKF PROW I`	600	600	400	552	552	552	532	385	530	480	535	535	32,5	32,5	3	-	-
Ia_{22-31}	$\hat{E}\frac{1}{2}A-65.50.15$ IP31 EKF PROW I`	650	500	150	602	452	602	440	135	580	388	585	440	32,5	30	3	-	-
Ia_{22-3}	$\hat{E}\frac{1}{2}A-65.50.22$ ($\hat{E}A\frac{3}{4}\frac{1}{2}-3$) IP31 EKF PROW I`	650	500	220	602	452	602	440	205	580	388	585	440	32,5	30	3	-	-
Ia_{22-07}	$\hat{E}\frac{1}{2}A-70.50.21$ ($\hat{E}\frac{1}{2}A-07$) IP31 EKF PROW I`	700	500	210	652	452	652	432	195	630	380	635	435	32,5	32,5	3	-	-
Ia_{22-4}	$\hat{E}\frac{1}{2}A-80.60.25$ ($\hat{E}A\frac{3}{4}\frac{1}{2}-4$) IP31 EKF PROW I`	800	600	250	745	545	752	540	235	730	488	740	545	30	27,5	4	-	-
Ia_{22-08}	$\hat{E}\frac{1}{2}A-90.70.26$ ($\hat{E}\frac{1}{2}A-08$) IP31 EKF PROW I`	900	700	260	845	645	852	632	245	830	580	420	645	30	27,5	4	-	420
Ia_{22-5}	$\hat{E}\frac{1}{2}A-100.65.30$ ($\hat{E}A\frac{3}{4}\frac{1}{2}-5$) IP31 EKF PROW I`	1000	650	300	945	595	930	585	285	454	533	457,5	598	42,5	26	4	454	457,5
Ia_{22-6}	$\hat{E}\frac{1}{2}A-120.75.30$ ($\hat{E}A\frac{3}{4}\frac{1}{2}-6$) IP31 EKF PROW I`	1200	750	300	1145	695	1120	676	285	549	624	557,5	690	42,5	30	5	549	557,5
Ia_{22-7}	$\hat{E}\frac{1}{2}A-132.75.30$ ($\hat{E}A\frac{3}{4}\frac{1}{2}-7$) IP31 EKF PROW I`	1320	750	300	1265	695	1222	700	285	600	648	617,5	714	42,5	18	5	600	617,5